


AI SECTION @ COLUMN A-2

1 1/2" = 1'-0" FI-EI

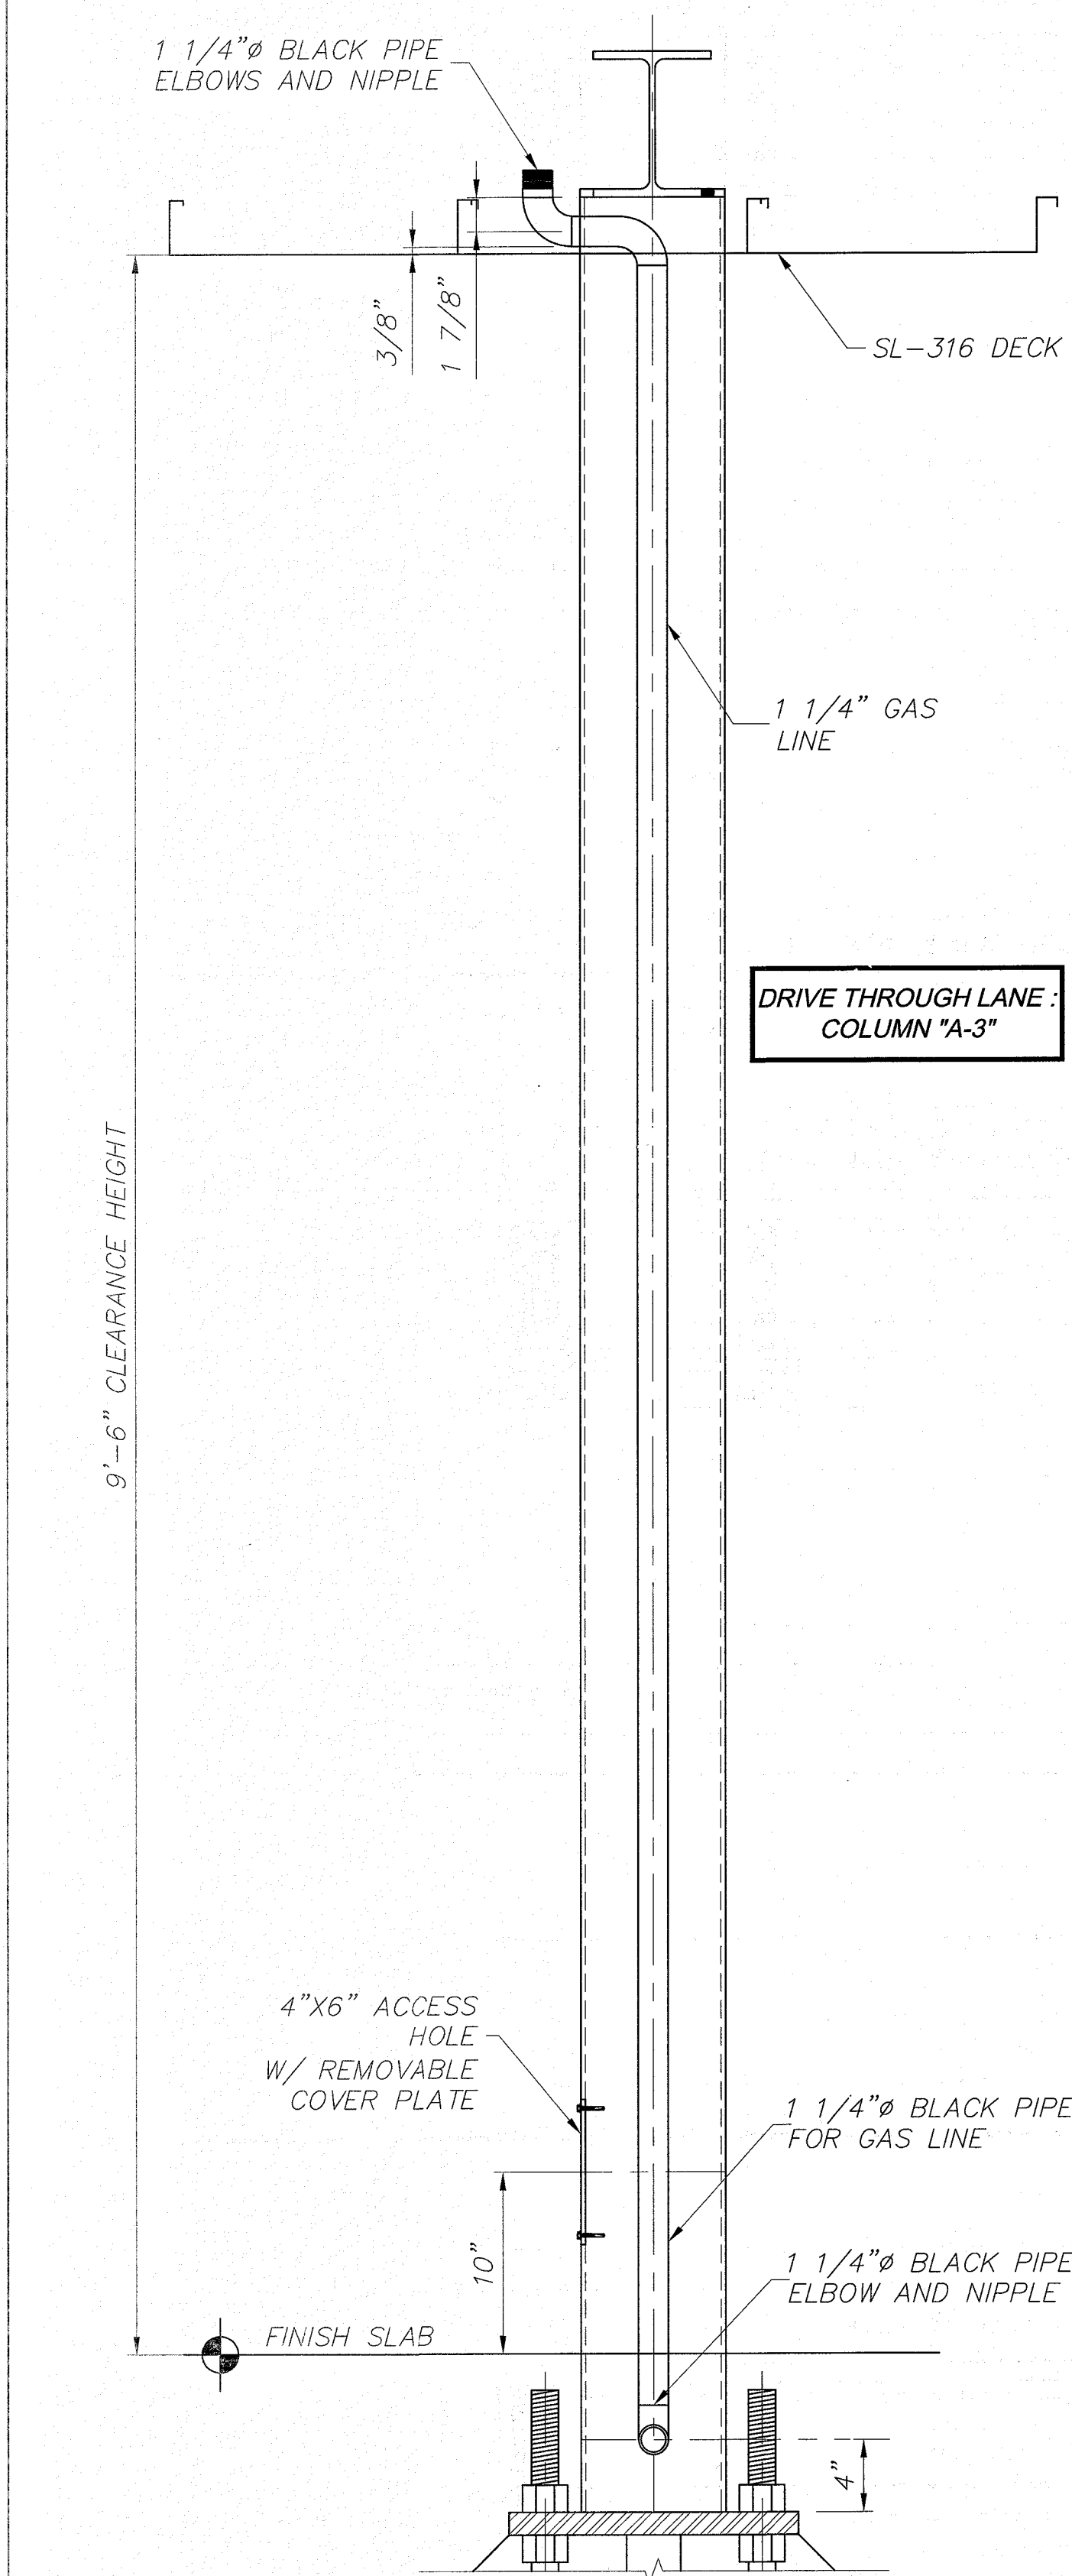

AIO SECTION @ COLUMN A-3

1 1/2" = 1'-0" FI-EI


LI4	NOT USED
N.T.S.	

FI4	NOT USED
N.T.S.	

DEAD LOAD = 3 p.s.f.(DECK + LIGHTS) + WEIGHT OF STRUCTURAL COMPONENTS
 LIVE LOAD = 20 p.s.f.
 SNOW LOAD = 5 p.s.f.
 V, ULT = 116 m.p.h. EXP C
 V, ASD = 90 m.p.h. EXP C
 BLDG CODE = 2012 INTERNATIONAL BUILDING CODE W/ GEORGIA AMENDMENTS 2014, 2015, 2017
 EQUIVALENT LATERAL FORCE PROCEDURE
 LATERAL FORCE RESISTING SYSTEM = CANTILEVERED COLUMN SYSTEM-ORDINARY STEEL MOMENT FRAME
 SITE CLASS = D
 $S_s(0.2) = 0.28$
 $S_1(1.0) = 0.11$
 $SDS = 0.29$
 $SD1 = 0.17$
 $F_a = 1.58$
 $F_v = 2.38$
 $R = 1.25$
 IMPORTANCE FACTOR = 1.0
 RISK CATEGORY = II
 SEISMIC DESIGN CATEGORY = B
 $CS = 0.232$
 CONSTRUCTION TYPE = IIB
 OCCUPANCY CATEGORY = M
 TOTAL SEISMIC BASE SHEAR BOTH DIRECTIONS = 0.94 KIPS

AI4 DESIGN LOADS

N.T.S.

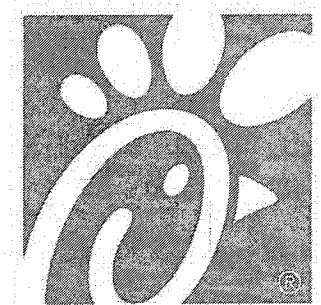

Chick-fil-A

Chick-fil-A
5200 Buffington Road
Atlanta, Georgia 30349-2998

LANE
SUPPLY, INC.
120 FAIRVIEW
ARLINGTON, TX. 76010
(817) 261-9116

SEAL:



DEC 2 2 2017

CHICK-FIL-A
SAR CHEROKEE PLACE. FSR
115 CHEROKEE PLACE.
CARTERSVILLE, GA 30121

FSR# 0534

REVISION SCHEDULE

NO.	DATE	DESCRIPTION

CONSULTANT PROJECT #	60005
PRINTED FOR	Permit
DATE	2017/12/19
DRAWN BY	AFG
CHECKED BY	RM

Information contained on this drawing and in all digital files produced for above named project may not be reproduced in any manner without express written or verbal consent from authorized project representatives.

SHEET

CANOPY SECTIONS

SHEET NUMBER

OMD-6
E4 OF 5