



- FAN #2 A2-G12-MPU - SUPPLY FAN
1. SUPPLY UNIT WITH 12" BLOWER IN SIZE #2 HOUSING
 2. INTAKE HOOD WITH E2 FILTERS-LOW CFM
 3. DOWN DISCHARGE- AIR FLOW RIGHT -> LEFT
 4. INSULATED BLOWER HOUSING SIZES 1-2 COMMERCIAL MODULAR BLOCKS
 5. CONTROL PACKAGE FOR MOD PACKAGE UNIT COOLING ONLY UNIT. INCLUDES AIRFLOW PROVING SWITCH, RTULINK-ACHP BOARD AND TERMINAL BLOCKS
 6. 5 TON, SINGLE CIRCUIT MODULAR PACKAGED COOLING OPTION FOR SIZE 2 MODULAR PACKAGED UNIT. INCLUDES CONDENSER, DX COIL, FILTER/DRYER KIT, THERMAL EXPANSION VALVE, R410A REFRIGERANT, AND REFRIGERANT PIPING (2,000 TO 3,000 CFM) NOT BUILT WITH OPPOSITE SIDE CONTROLS OR OPPOSITE AIRFLOW DIRECTION. CONDENSERS REQUIRE SEPARATE 208V, 3 PHASE POWER SUPPLY. COIL = 3E2/1001R
 7. SUPPORT SHELL FOR SIZE 2 MODULAR PACKAGE UNIT. INCLUDES CONTROL VESTIBULE. INCLUDES CONDENSER SUPPORTS. DOES NOT INCLUDE RETURN AIR OR INLET AIR DAMPER.
 8. SEPARATE 120VAC WIRING PACKAGE FOR MAKE-UP AIR UNITS. OPTION MUST BE SELECTED WHEN MOUNTING VFD IN PREWIRE PANEL OR WITH DCV PACKAGE. PROVIDES SEPARATE 120VAC INPUT TO SUPPLY FAN. THIS 120V SIGNAL MUST BE RUN BY ELECTRICIAN FROM DCV TO MUA SWITCH.

NOTE: SUPPLY DUCT MUST BE INSTALLED TO MEET SMACNA STANDARDS. A MINIMUM STRAIGHT DUCT LENGTH EQUAL TO THREE TIMES THE SUPPLY DUCT EQUIVALENT DIAMETER MUST BE MAINTAINED DOWNSTREAM OF UNIT DISCHARGE UNLESS OTHERWISE SPECIFIED. DO NOT RELY ON UNIT TO SUPPORT DUCT IN ANY WAY.

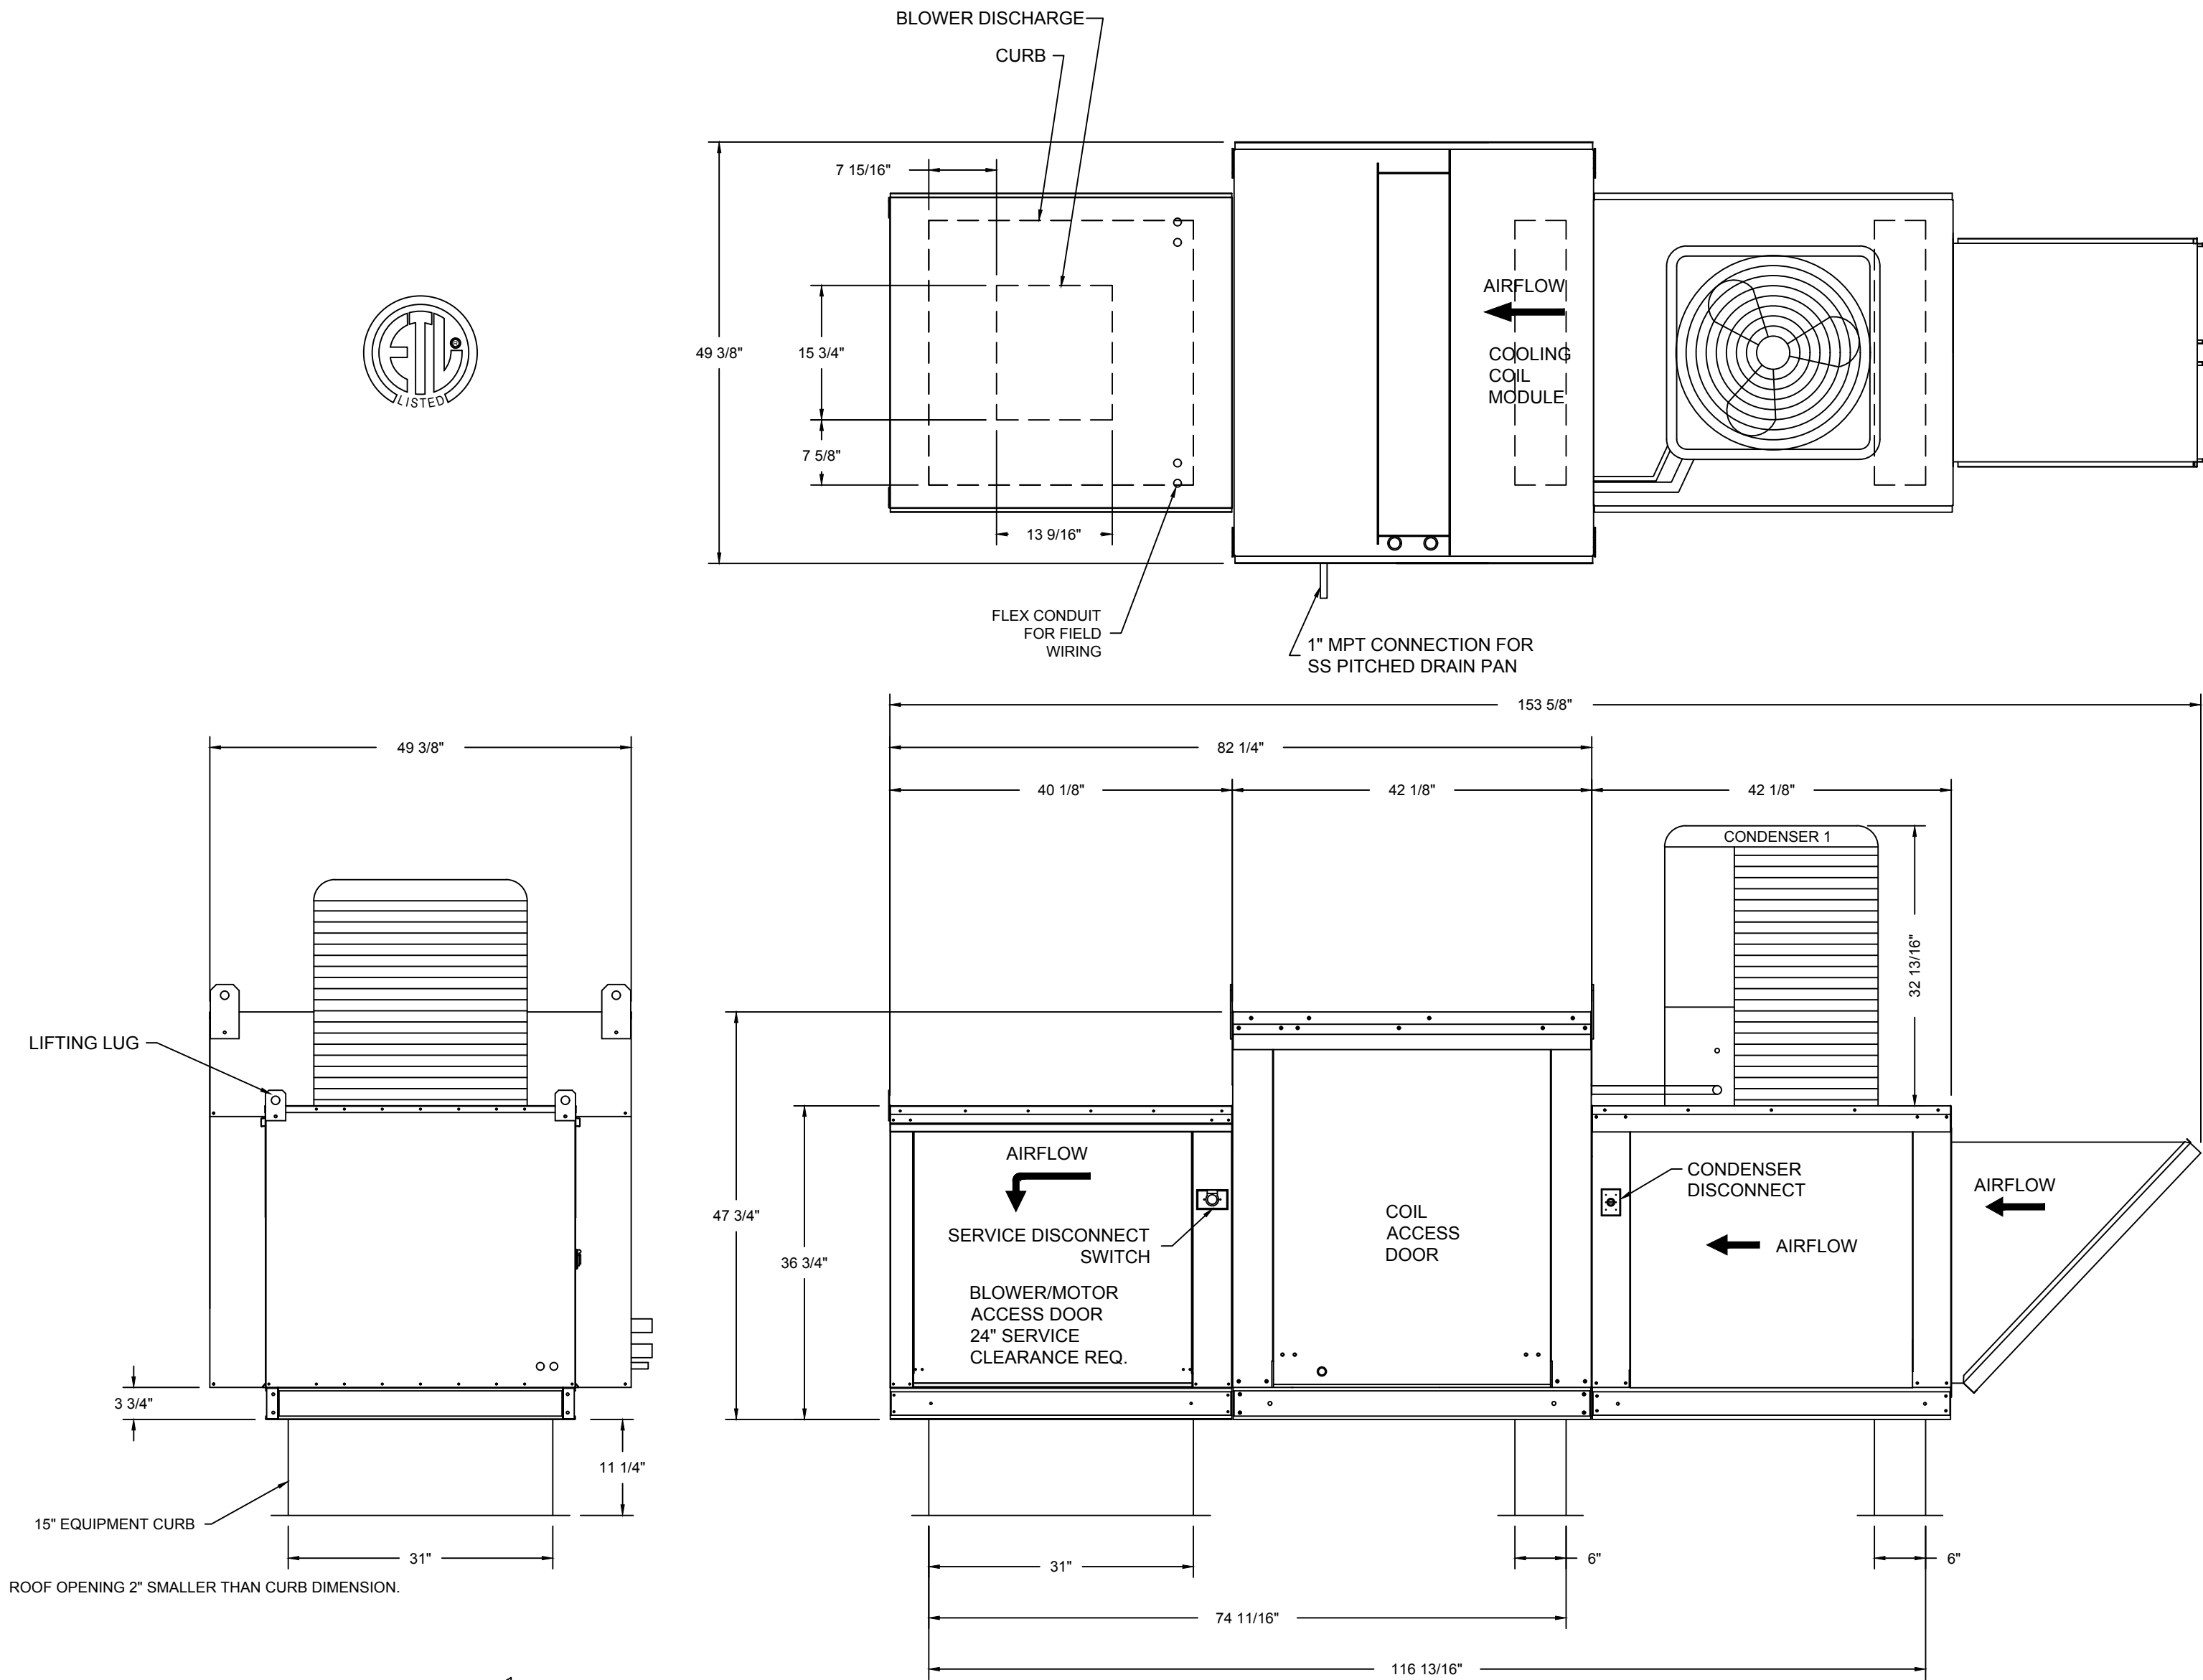


PITCHED CURBS ARE AVAILABLE FOR PITCHED ROOFS.

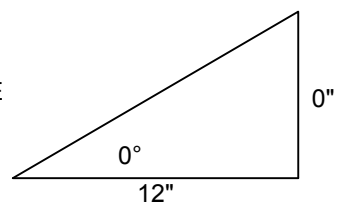


SPECIFY PITCH:
EXAMPLE: 7/12 PITCH = 30° SLOPE

Typical Drain Trap Install

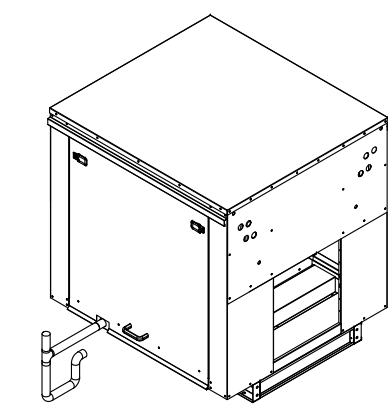


Recommended Cooling Coil Drain Trap Configuration

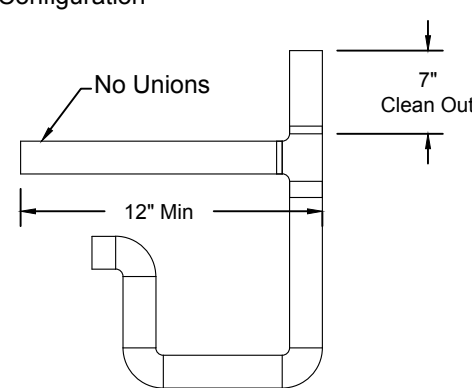

- Notes:
- 1) 1" diameter PVC Pipe only
 - 2) Use only low profile couplings
 - 3) Add clean out as shown

REVISIONS	
DESCRIPTION	DATE:
Δ	
Δ	
Δ	
Δ	

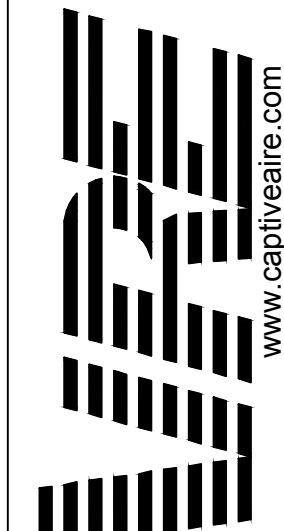

Southern California Office

3002 Dow Ave., Suite 410, Tustin, CA 92780 PHONE: (714) 957-1500 FAX: (919) 227-5975 EMAIL: reg86@captiveaire.com

Del Taco - Hiram GA
4525 Jimmy lee Smith Parkway,
HIRAM, GA, 30141

DATE: 4/6/2018

DWG.#:
3364331


DRAWN
BY: AHJ-86

SCALE:
3/4" = 1'-0"

MASTER DRAWING


SHEET NO.
3

REVISIONS	NO
4/28/2018	
5/15/2018	

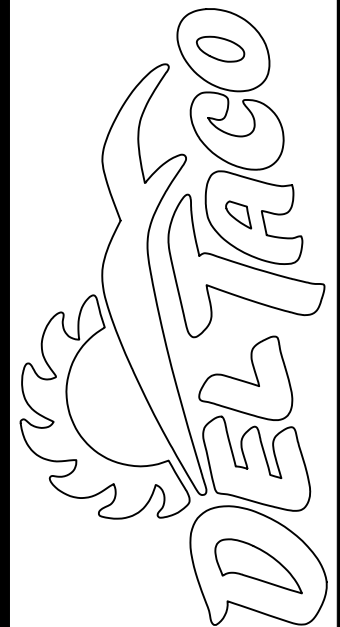

Del Taco - Hiram, GA 30141

4525 Jimmy Lee Smith Pkwy

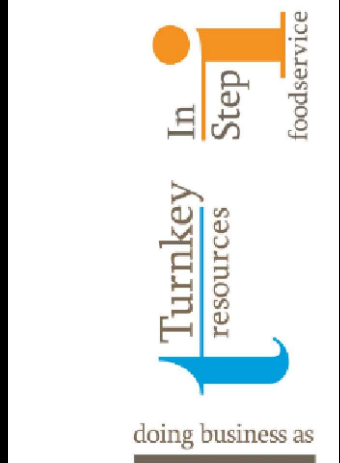

DRAWN:
CHECKED:
DATE:
4/5/2018
SCALE:

K10
SHEET

OF 11 SHEETS